


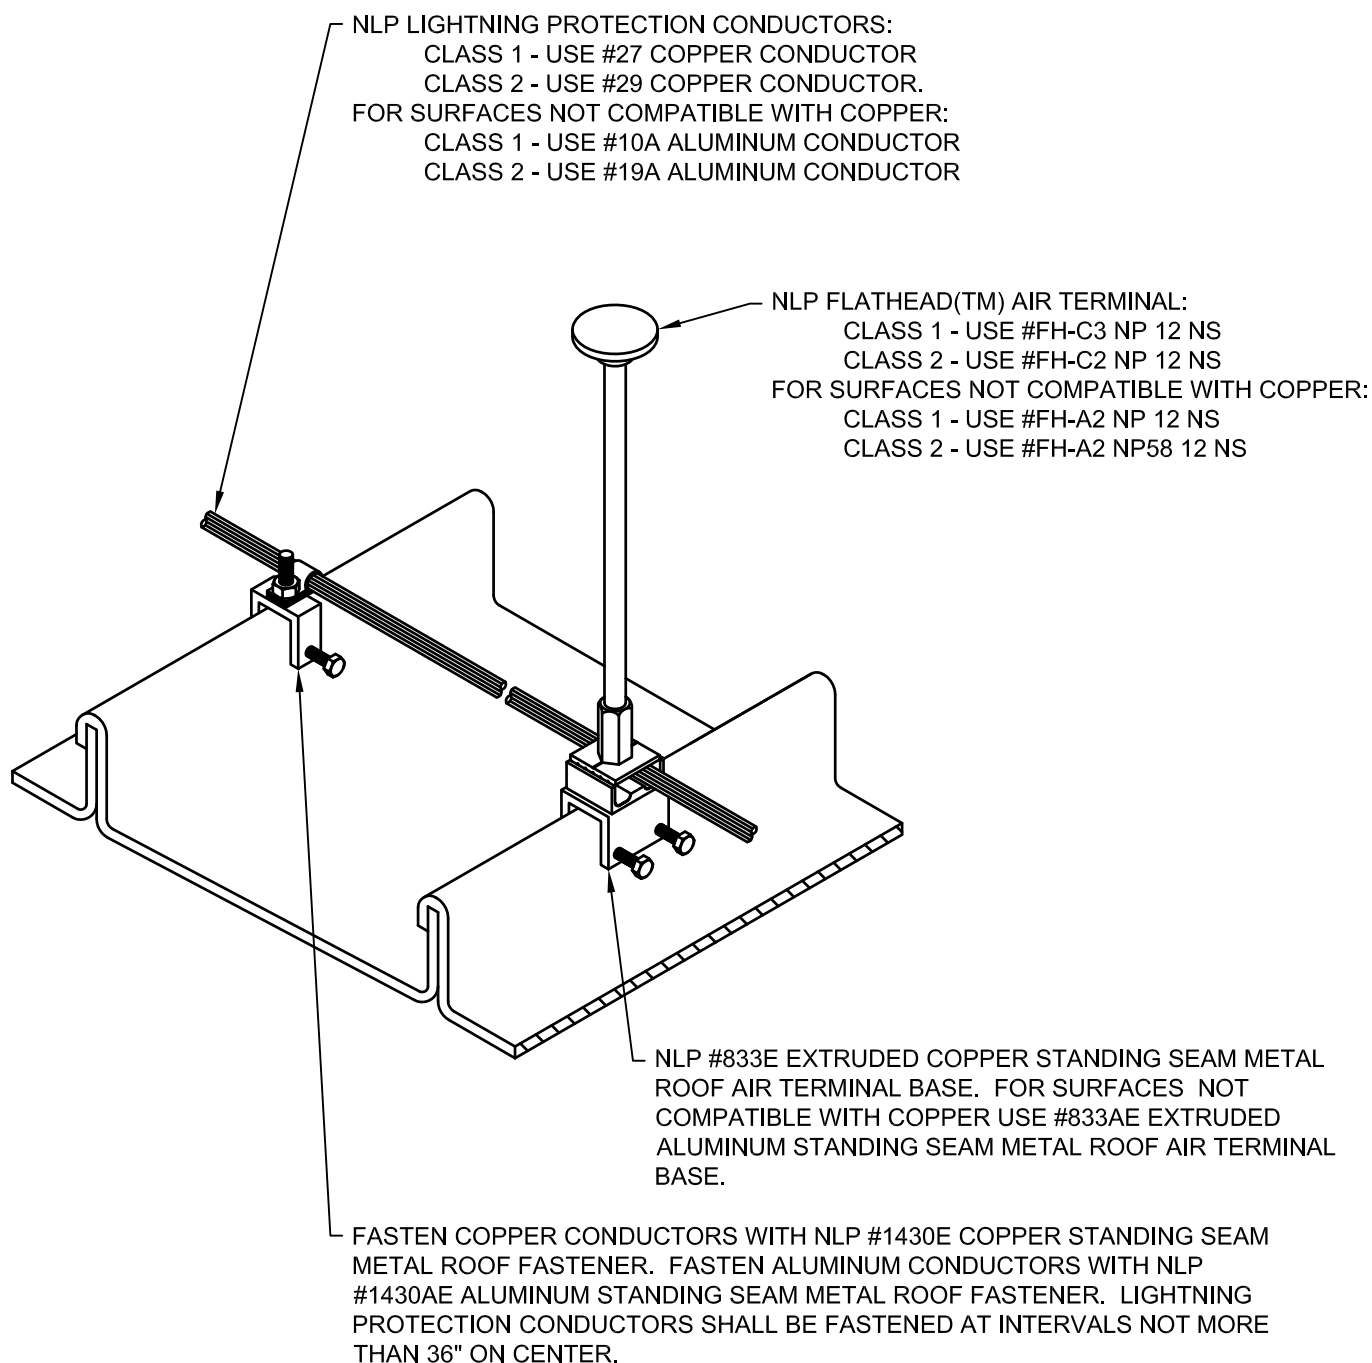

NOTES:

AIR TERMINAL SPACING SHALL CONFORM TO NFPA 780 & UL 96A REQUIREMENTS.

MATERIAL COMPATIBILITY SHALL CONFORM TO NFPA 780 & 96A REQUIREMENTS.

MATERIAL CLASS SHALL CONFORM TO NFPA 780 & UL 96A REQUIREMENTS.

AIR TERMINALS SHALL BE UL LISTED & CAL-OSHA APPROVED.

LPD-A6

STANDING SEAM ROOF AIR TERMINAL DETAIL

05/2012

FRANKLIN ROD LIGHTNING PROTECTION SYSTEM

NATIONAL LIGHTNING PROTECTION
 13550 Smith Road, Suite 150
 Aurora, Colorado 80011
 1-800-628-2816